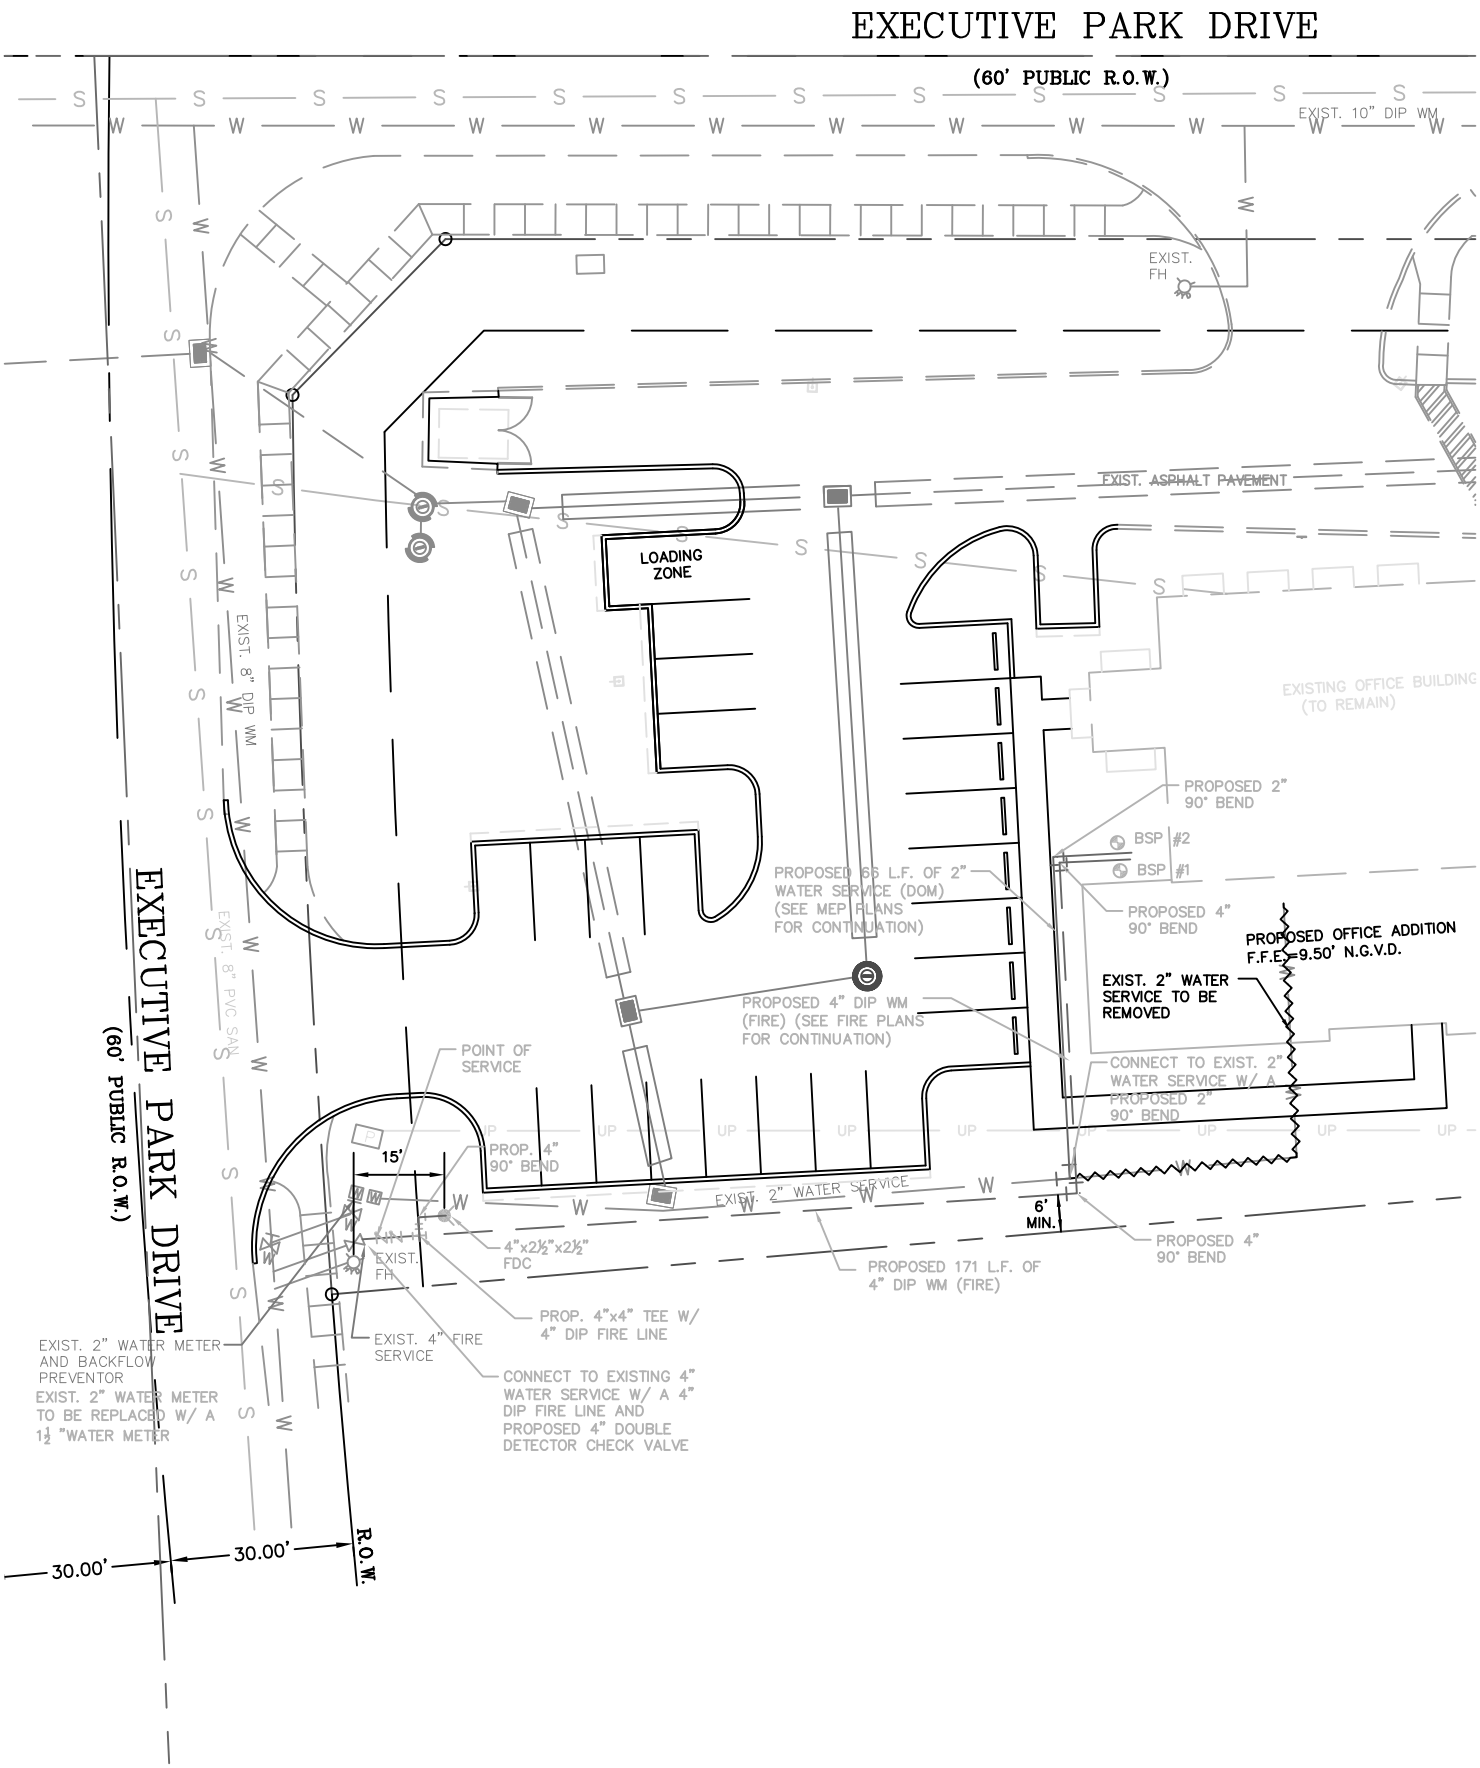
EXECUTIVE PARK DRIVE
(60' PUBLIC R.O.W.)
EXIST. 10" DIP WM
EXIST. FH
EXIST. ASPHALT PAVEMENT
LOADING ZONE
EXIST. 8" DIP WM
EXISTING OFFICE BUILDING (TO REMAIN)
PROPOSED 2" 90° BEND
BSP #2
BSP #1
PROPOSED 66 L.F. OF 2" WATER SERVICE (DOM) (SEE MEP PLANS FOR CONTINUATION)
PROPOSED 4" 90° BEND
PROPOSED OFFICE ADDITION F.F.E.=9.50' N.G.V.D.
EXIST. 2" WATER SERVICE TO BE REMOVED
PROPOSED 4" DIP WM (FIRE) (SEE FIRE PLANS FOR CONTINUATION)
CONNECT TO EXIST. 2" WATER SERVICE W/ A PROPOSED 2" 90° BEND
EXIST. 8" PVC SAN
EXECUTIVE PARK DRIVE
(60' PUBLIC R.O.W.)
POINT OF SERVICE
15'
PROP. 4" 90° BEND
EXIST. 2" WATER SERVICE
6' MIN.
PROPOSED 4" 90° BEND
4"x2½"x2½" FDC
EXIST. FH
PROPOSED 171 L.F. OF 4" DIP WM (FIRE)
PROP. 4"x4" TEE W/ 4" DIP FIRE LINE
EXIST. 2" WATER METER AND BACKFLOW PREVENTOR
EXIST. 4" FIRE SERVICE
EXIST. 2" WATER METER TO BE REPLACED W/ A 1½ "WATER METER
CONNECT TO EXISTING 4" WATER SERVICE W/ A 4" DIP FIRE LINE AND PROPOSED 4" DOUBLE DETECTOR CHECK VALVE
30.00'
30.00'
R.O.W.